

As just stated, it is susceptible of easy introduction into old stables and may be readily and conveniently installed in new buildings. A study of diagrams given will show probably the best relative positions for inlets and outlets. There is, however, but slight objection to any number of other possible or necessary different arrangements.

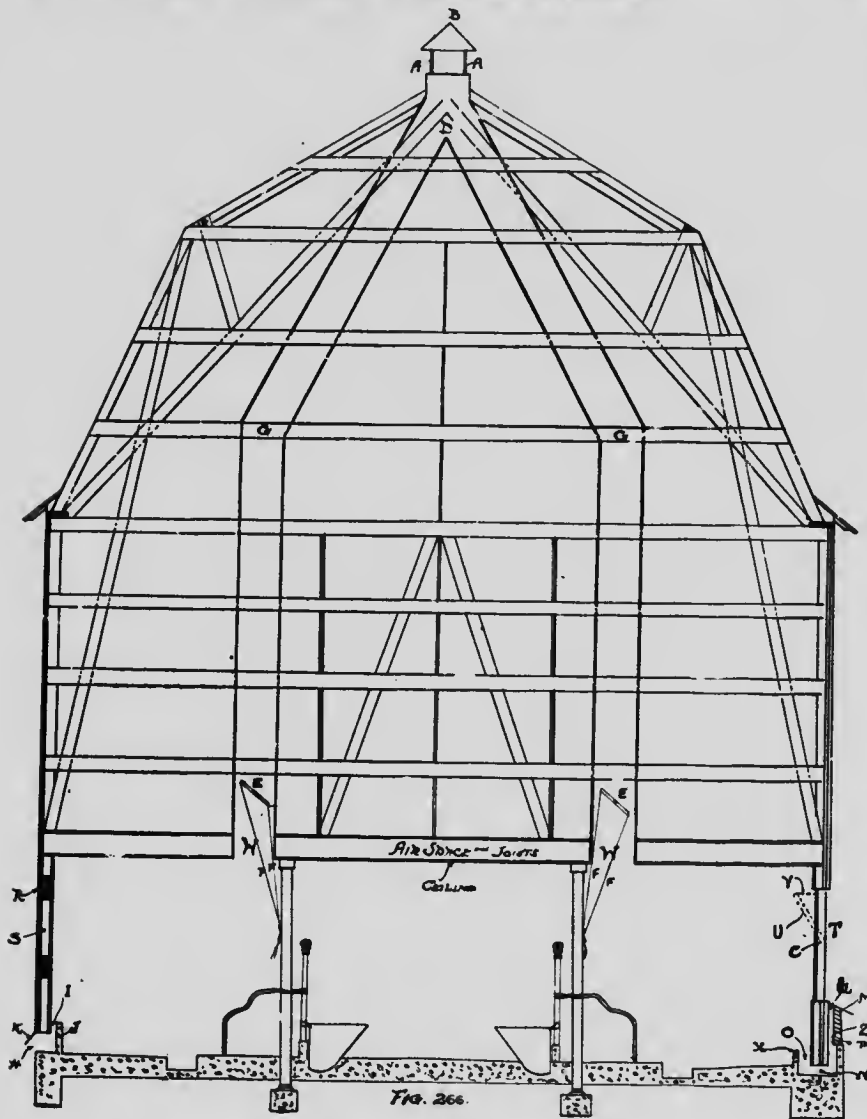


Fig. 242, showing floor plan of a stable for, say, 24 cattle, also illustrates probably the best relative positions of fresh air intakes A A A A A and foul air outlets B B (beginnings of shaft in ceiling, see W D, Fig. 244). This arrangement suits where nothing in use in the loft or superstructure interferes in any way.