


Ottawa's Finest Hotel

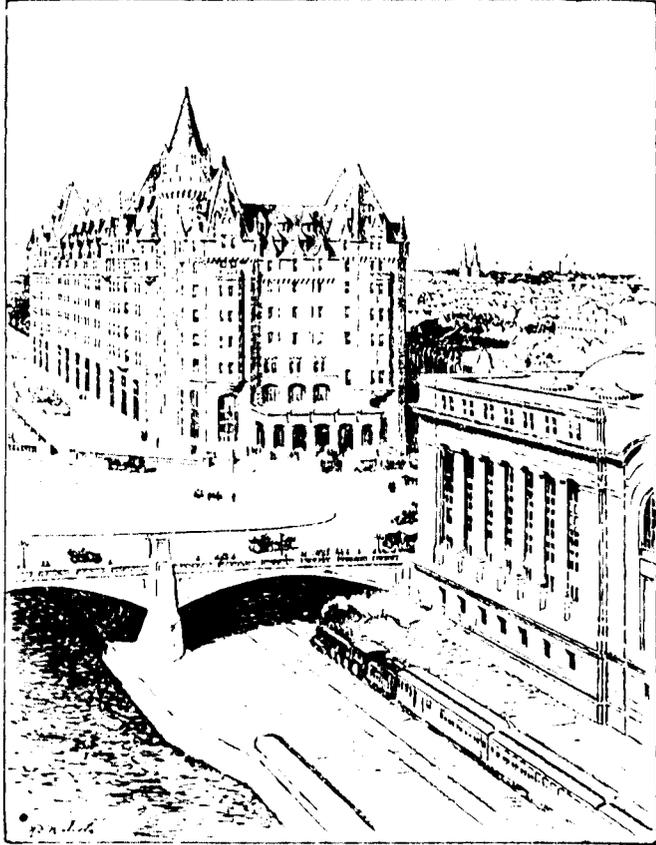

Architects—Ross & McFarlane,
Montreal.

Engineers—Westinghouse, Church,
Kerr & Company, New York.

Electrical Contractors—Western
Electric Company, New York.

CHATEAU LAURIER AND GRAND TRUNK CENTRAL STATION, OTTAWA

Equipped with Canada's Finest Wire "Adanac" (Rubber Insulated)

"Adanac" Rubber Insulated Wire (Black Core) is regularly furnished on wires and cables for 600-volt National Electrical Code requirements. It can, however, be used on higher potentials.

This wire has a yellow thread woven spirally in the braid for identification

purposes. The yellow thread may be quickly discovered by soaking the braid in gasoline or naphtha. This is necessary in order to remove the black wax compound. Look for the yellow thread.

Address inquiries to nearest office.

Northern Electric Company
LIMITED

SUCCESSORS TO IMPERIAL WIRE & CABLE CO., LIMITED.

MONTREAL
HALIFAX
TORONTO

WINNIPEG
REGINA
CALGARY

EDMONTON
VANCOUVER
VICTORIA