


PLATE III.



Explanation.

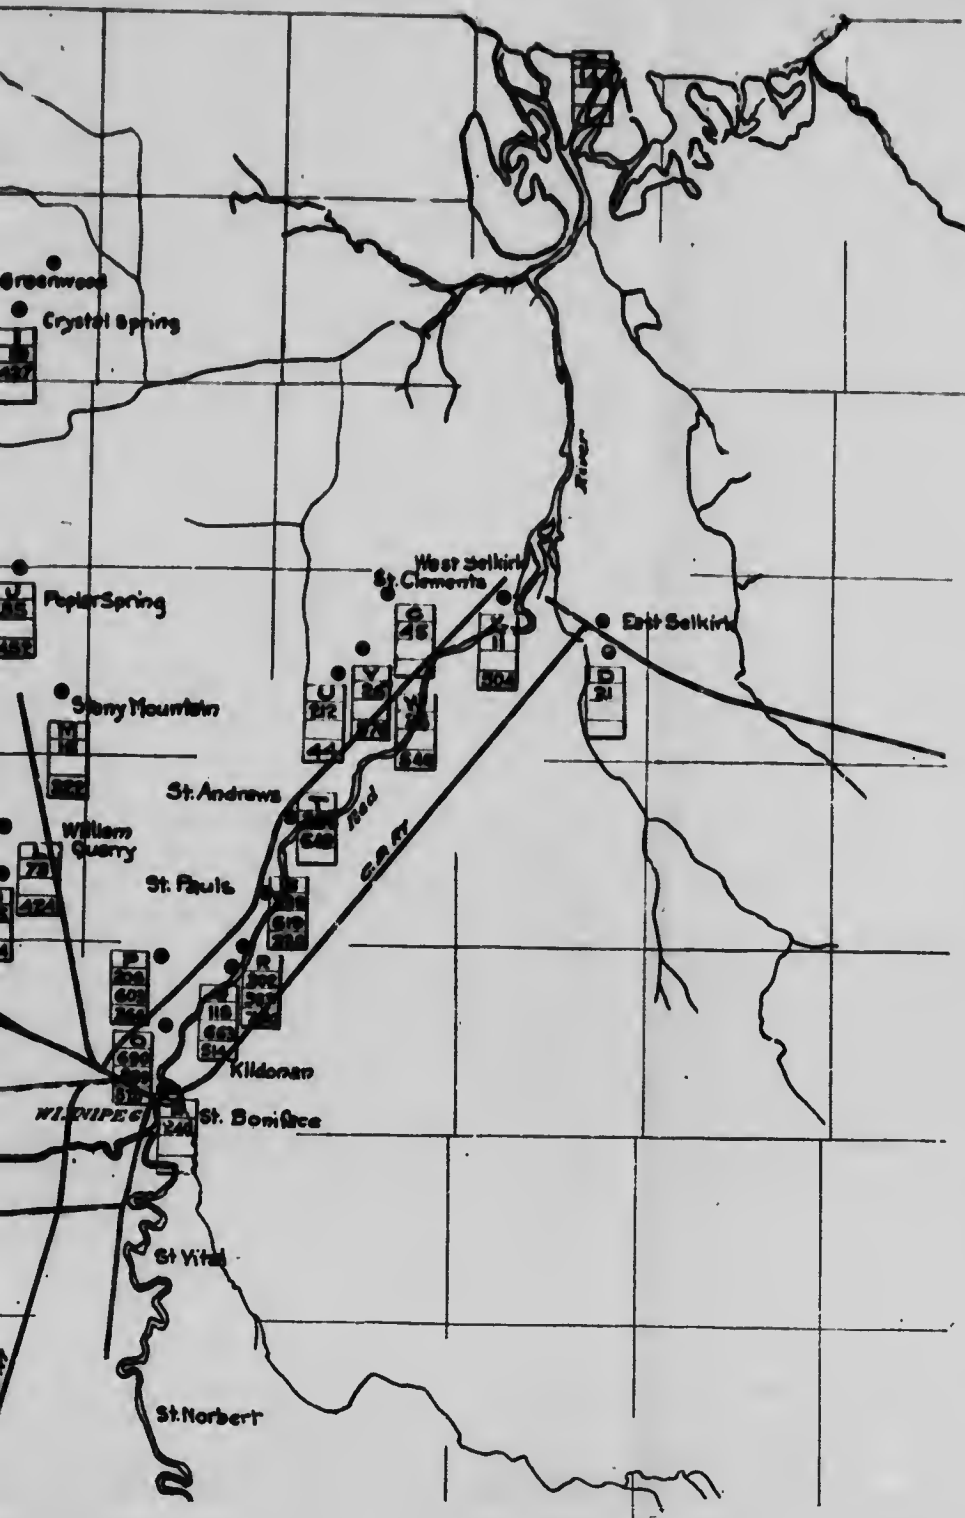

*Letter designating Sample
Number showing amount of Chlorine
Residual*

WINNIPEG WATER SUPPLY COMMISSION

**To Accompany Report of
BOARD OF CONSULTING ENGINEERS.**

James H. Fuertes,
R. S. Lee,
J. E. Schwitzer,
George C. Whipple
August 29, 1907.